

()

: ADBD2020R_2020042307165020200810205522101971410912

: 2020-08-10 20:55:22

: --
:
:

/

()
()

Springer

Taylor & Francis

)

CNKI

-

: 1900-01-01 2020-08-10

//

	0.9%		0%
引	0.9%	总	0.9%
单	0.9%	2016	,
& t;	...		
[40]		[4505]	[40]
[1]		[40]	[40]
[1]		[0]	[40]
<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
0	2	0	0



1.	--	4505
	0.9%(40)	0.9%(40)
		(0)
1	2016	& t;
	...	0.9% 40
	http://www.vorl.duc.c	- 2016

“

”

2

6KV630KVA

6KV

()

1

"

10KV


"

GB50053-2009

2

()

//



()

"

GB50053-94

--

--

--PT

--

--

10KV

--

$P=630KVACOS$ $=0.8($)
 () 800kw

96A

95MVA

50MVA,

0.5km

a

b

c

d

;

a

Max min:

max : min:

1

A

C

B

4

2

1.5s

5-10A


5-10A DL-11/

3

108

1.25

1ZJ1CFQFHC
4
2ZJ2CF+---

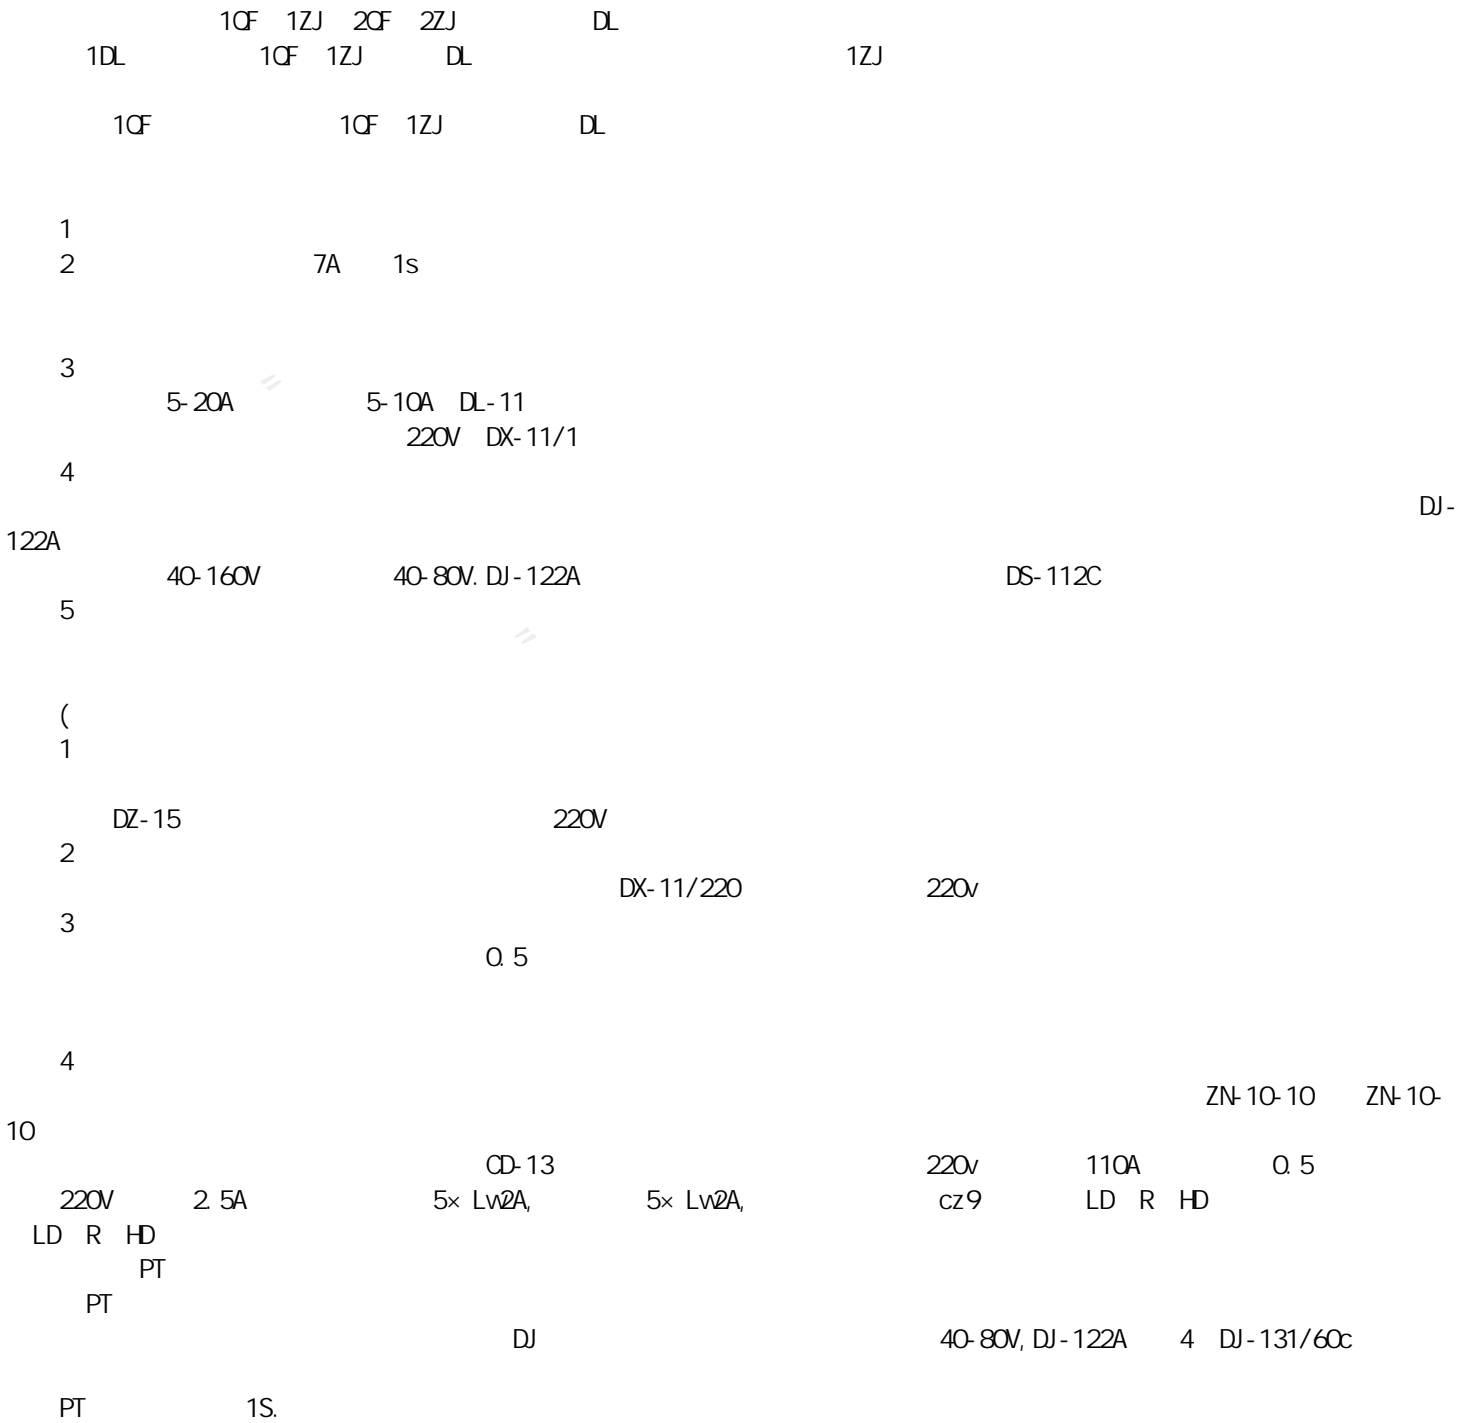

[1] . [M]. 2 2016.
[3] . [M]. 3 2016.
[4] . [M]. 1 . 2014.

[5]
[6]
[7]
[8] 10kV

[M]. 2 .
GB50052- 2009
GB50053- 94

2016.
. 2009.

1.

- 1.
- 2.
- 3.
- 4.
- 5.
- 6.
- 7.



 amc@cnki.net

 <http://check.cnki.net/>

 <http://e.weibo.com/u/3194559873/>